





LEVEL 2 - ELECTRICAL RENOVATION PLAN SCALE 1/8" = 1' - 0"

KEYED RENOVATION NOTES:

- THE ELECTRICAL CONTRACTOR SHALL PUT BACK ALL CEILING MOUNTED LIGHT FIXTURES, SPEAKERS, FIRE ALARM DEVICES, AND ANY OTHER ELECTRICAL-RELATED CEILING MOUNTED DEVICE OR EQUIPMENT REMOVED TO ACCOMMODATE HVAC RENOVATION WORK. REINSTALL AND RECONNECT FIXTURES AND DEVICES AS BEFORE AND ASSURE PROPER OPERATION. IT SHALL BE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO REPAIR OR REPLACE TO THE VA'S SATISFACTION ANY FIXTURES OR DEVICES THAT BECOME DAMAGED DURING AND AS A RESULT OF THIS PROCESS.
- THOROUGHLY CLEAN INSIDE & OUTSIDE OF ALL ACRYLIC LENS AND INSTALL NEW FO28/841/XP/SS/ECO LAMPS IN ALL FIXTURES SHOWN ON THIS DRAWING.
- (3) CONTROLS POWER PANEL LOCATED ABOVE ACCESSIBLE CEILING FURNISHED & INSTALLED BY CONTROLS CONTRACTOR. PROVIDE 20A, 120V CIRCUIT AS SHOWN.
- (4) CONNECT TO SPARE 20A/1P CIRCUIT BREAKER IN EXISTING PANELBOARD 'E2A', 'EC2A', OR 'EC2A2'. IF NO SUCH SPARE EXISTS, FURNISH & INSTALL A NEW 20A/1P CIRCUIT BREAKER IN AVAILABLE SPACE. NEW CIRCUIT BREAKER SHALL BE OF THE SAME MANUFACTURER AS THE PANELBOARD AND SHALL BE THE SAME TYPE AND HAVE THE SAME INTERRUPTING RATING AS EXISTING CIRCUIT BREAKERS ALREADY INSTALLED IN THE PANELBOARD.



ASBESTOS NOTE:
IF THE EXECUTION OF THIS WORK REQUIRES THE DISTURBING OF ANY SUBSTANCE WHICH APPEARS TO BE ASBESTOS OR WHICH MAY CONTAIN ASBESTOS FIBER, NOTIFY THE OWNER BEFORE CONTINUING WORK AT THE SUSPECT LOCATION. ANY MATERIAL TESTING POSITIVE SHALL BE REMOVED BY THE OWNER BEFORE WORK CONTINUES. NOTE: EXISTING CONDITIONS SHOWN WERE DERIVED FROM OWNER FURNISHED DRAWINGS AND FIELD OBSERVATIONS. SOME BUILDING FEATURES AND MEP SYSTEMS ARE NOT SHOWN FOR CLARITY. FIELD VERIFY BUILDING CONSTRUCTION. FIELD VERIFY THE LOCATION, SIZE AND QUANTITY OF ALL EQUIPMENT.

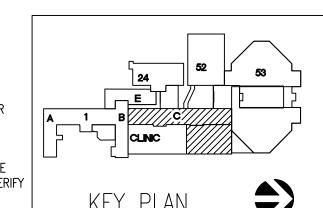

| REVISIONS: | DESCRIPTION: | DATE: | |
|------------|--------------|-------|--|
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

| Dept. of Veterans Affair Jack C. Montgomery Medical Center 1011 Honor Height Drive Muskogee Oklahoma 74 |
|---|
| Muskogee, Oklahoma 74 |
| |

| TE. 214 174 M: 5183 |
|---------------------------|
| ΓΕ. 214 174 Μ: 5183 |

| CONSULTANTS: |
|--|
| ARCHITECT: ARCHITECTURAL CONCEPTS, IN 669 AIRPORT FREEWAY, STE. 30 HURST, TX 76053 P: 817-285-8885 F: 817-285-8021 |

| APPROVED: | APPROVED: Interior Designer |
|-----------|-----------------------------|
| APPROVED: | APPROVED: |
| APPROVED: | APPROVED: |
| APPROVED: | APPROVED: |

APPROVED: Safety Manager

APPROVED: Infection Control Nurse

APPROVED: Industrial Hygienist

APPROVED: President A.F.G.E. 2250

APPROVED: Medical Center Director

APPROVED: Chief of Engineering Service

CLINICAL

APPROVED: Associate Director

APPROVED: Chief of Staff

| DRAWING TITLE | | PROJECT TITLE | | | DA' |
|--|---------------------------------|--|---------------|---------------------------------------|-----|
| LEVEL 2, CLINICAL WING: ELECTRICAL DEMO PLAN | | REPLACE LABORATORY AIR HANDLING UNITS | | SCA | |
| PROJECT NO. 623-11-107 | CONTRACT NO. VA256-12-C-0295 | DESIGNED BY: TGB | DRAWN BY: TGB | CHECKED BY: SRC | DRA |
| BUILDING NO. | AUTOCAD FILE NAME: | LOCATION | | · · · · · · · · · · · · · · · · · · · | |

Jack C. Montgomery VA Medical Center

| SCALE: NO SCALE | - |
|-----------------|---|
| DATE | |
| 8/19/2013 | [|
| SCALE: | ` |
| AS SHOWN | |
| DRAWING NO. | |
| EP1.0 | T |

| 8/19/2013 | OF FAIR |
|---------------|------------------------|
| SCALE: |) 开 |
| AS SHOWN | |
| DRAWING NO. | ME NS |
| EP1.0 | EPARTMENT ETERANS A |
| DWG. 32 OF 40 | DE VE |